


(機器上からの透視図)




 環境の保全
 省エネルギー
 暖・冷房システム（熱源機・湯暖）

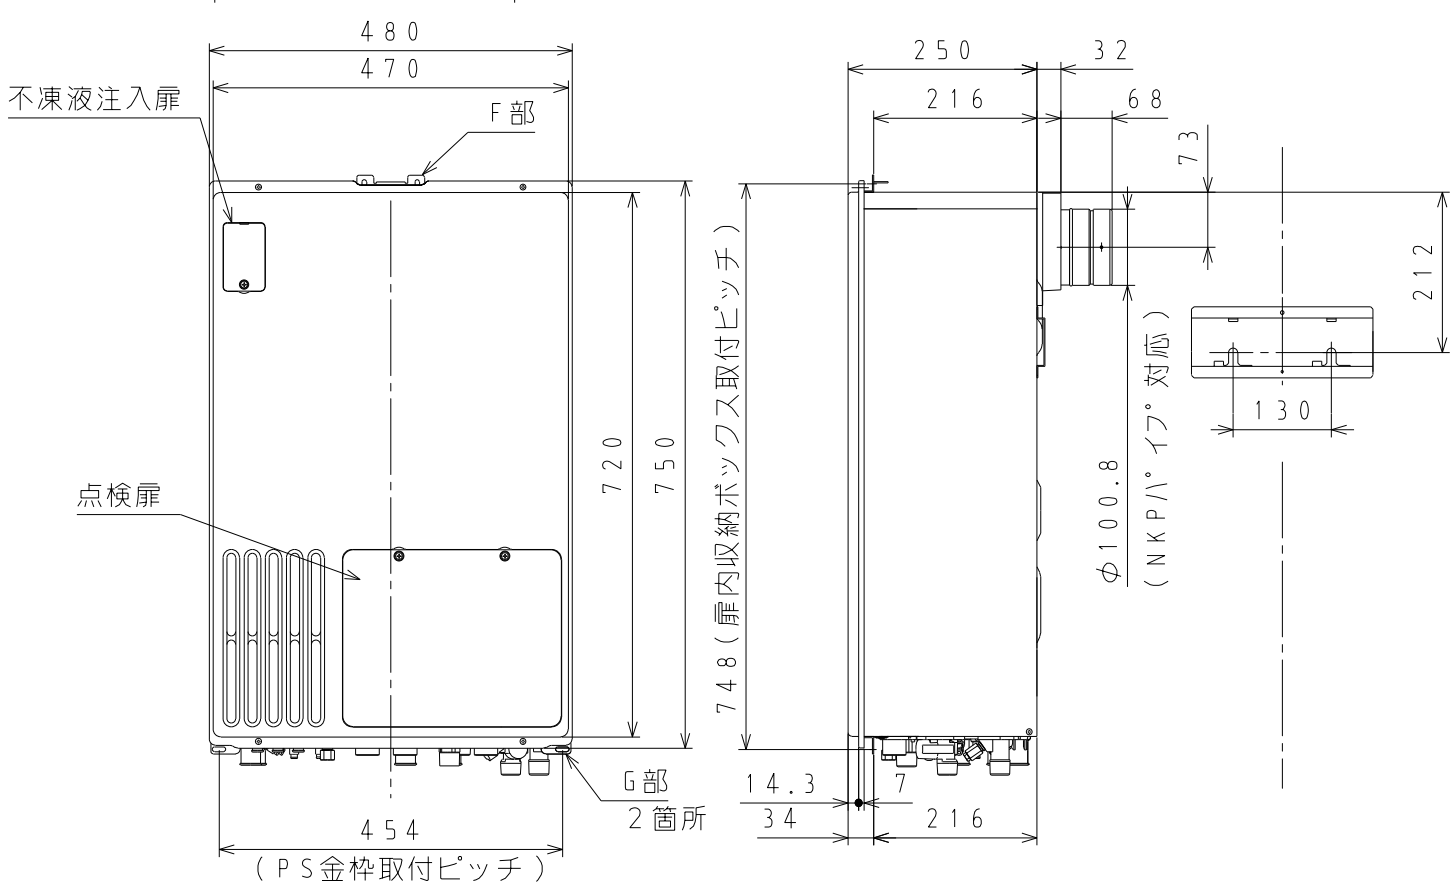

Technical drawing of a mechanical part showing front and top views with dimensions.

Front View (Top):

- Overall width: 90
- Overall height: 18
- Two vertical centerlines are shown.

Top View (Bottom):

- Overall width: 90
- Overall depth: 23
- Internal width: 70
- Internal depth: 14
- Bottom-left corner radius: R_3
- Bottom-right corner radius: R_3
- Bottom edge features a small semi-circular notch and a circular hole.
- Vertical dimensions on the left: 14 (from top edge to internal width line), 11 (from internal width line to bottom edge), and 23 (total depth).

配 管 口 径	施 工 条 件	浴槽あふれ縁までの高さ
10A樹脂管	通常1.5mまで (設定変更により2.5mまで対応可)	※ -5~7m以内

配管口径	施工条件
1/2銅管	通常15mまで
3/8ペアチューブ	最大15m10曲がり

機 外 揚 程	暖房ポンプ	高温	40kPa (10 $\frac{1}{2}$ /min)
			1 系統 60kPa (3.5 $\frac{1}{2}$ /min)
	低温		2 系統 52kPa (7 $\frac{1}{2}$ /min)
			3 系統 76kPa (10.5 $\frac{1}{2}$ /min)
			4 系統 64kPa (14 $\frac{1}{2}$ /min)
			5 系統 54kPa (16 $\frac{1}{2}$ /min)
			6 系統 50kPa (17 $\frac{1}{2}$ /min)

暖房水タンク容量	1.3㍑(有効0.8㍑)
許容システム水量	銅管:24.0㍑ 樹脂管:35.0㍑

ガ ス	4 0
水	5 1
湯	5 1
追いだき往・戻	3 8
暖房低温往	2 4
暖房高温往	3 8
暖房戻	3 8
ド レ ン	2 5
電 気	2 5

給水装置認証番号：NW2019

品 名	X T 4 2 1 9 A R S B A W 3 C			
型 式	G H - H 2 4 3 Z (A) B			
設 置 方 式	P S 扉内設置型 (後方排気延長)			
製品質量 (k g)	4 3 (満水時 4 6)			
ガ ス 種 類	1 3 A			
ガス消費量 (kW)	給 湯	44.2 (38,000 kcal / h)		
	暖 房	16.1 (13,800 kcal / h)		
	同 時	58.1 (50,000 kcal / h)		
能 力 (kW)	給 湯	41.9 (24.0 号) ~ 0.17 (0.1 号) (比例制御)		
	追いだき	9.88 (8,500 kcal / h)		
	暖 房	14.0 kW (12,000 kcal / h) ~ 2.3 kW (2,000 kcal / h) 比例		
熱効率 (%)	給湯・湯張り	95.0		
	暖 房	87.0 (低温 87.0、高温 87.0)		
	1 次 効 率	93.0		
	達成率	112		
騒 音 値 (dB (A))	49 (給湯・暖房・同時使用時)			
点 火 方 式	ダイレクト着火方式			
給 排 気 方 式	強制排気式			
最大出湯量	29.0 l / min			
最低作動流量	1.9 l / min			
最低作動水压	10.0 kPa (0.1 kgf / cm ²) (機器のみの場合)			
使用水压 (動圧)	100 ~ 750 kPa (1.0 ~ 7.5 kgf / cm ²)			
温度制御方式	給湯	比例制御		
	暖房	比例制御		
追いだき方式	直接加熱式			
配 管 口 径	給水・給湯	20 A (R 3 / 4) オネジ		
	追いだき往・戻	Q F 16 (C C H M) シ' ョイント		
	暖房低温往	C H M シ' ョイント (3 P)		
	暖房高温往・戻	Q F 16 (C C H M) シ' ョイント		
	ド レ ン	15 A (R 1 / 2) オネジ		
	ガ ス	20 A (R 3 / 4) オネジ		
	電 気	C 3 1 (呼び径)		
中和剤	寒水石			
電 気 特 性	電 源	AC 100 V		
	リモコン	24 V 以下		
	消費電力	待機時	1.5 W (浴室・台所リモコン取付時)	
		同時使用	280 W	
		凍結予防	最大 330 W	
安 全 装 置	給湯側水量検知装置 (水量センサー方式) ファン回転検出装置 (燃焼ファン) 立消え安全装置 (フレームロック方式) 残火安全装置 (バイメタル方式) 過圧防止安全装置 (スプリング方式) 水位確認装置 (水位電極方式) 凍結予防装置 (電気ヒーター + ポンプ運転) 漏電安全装置 (漏電リレー方式) 過熱防止装置 (温度ヒューズ方式) 誘導電保護装置 (サージアブソーバー方式)			
付 属 品	取扱説明書 工事説明書 中継リノ線 (一式) 取付ネジ (一式)			
別 売 部 品	浴室リモコン 台所リモコン 増設リモコン (各種) 扉内収納ボックス (S8 - B105) 循環アダプタ リモコンコード 電力測定ユニット (EM - 02) エコネットライトアダプター (ELA - 01)			

417-8505

静岡県富士市西柏原新田201

管理番号	NS19-172-00
------	-------------

名 称 24号 給湯暖房用熱源機
強制循環タイプ・全自動タイプ

品 名	XT4219ARS8AW3C		
提出年月日	年 月 日	单 位	mm

受領印				
-----	--	--	--	--

受領年月日	年	月	日
-------	---	---	---